
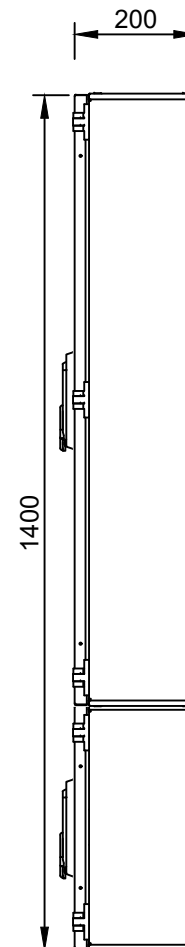
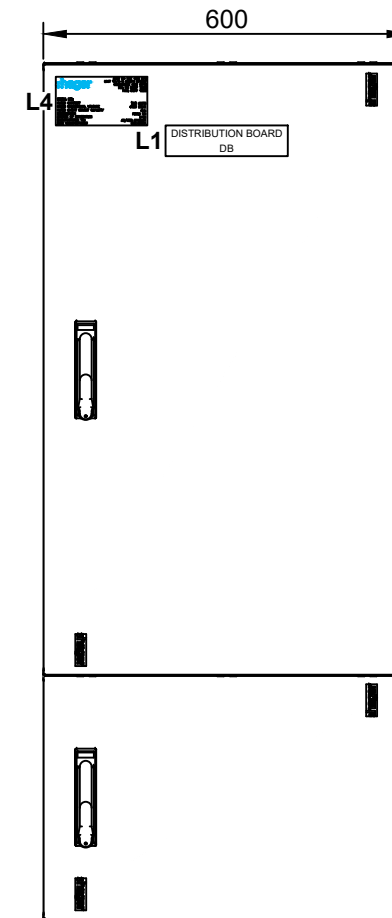
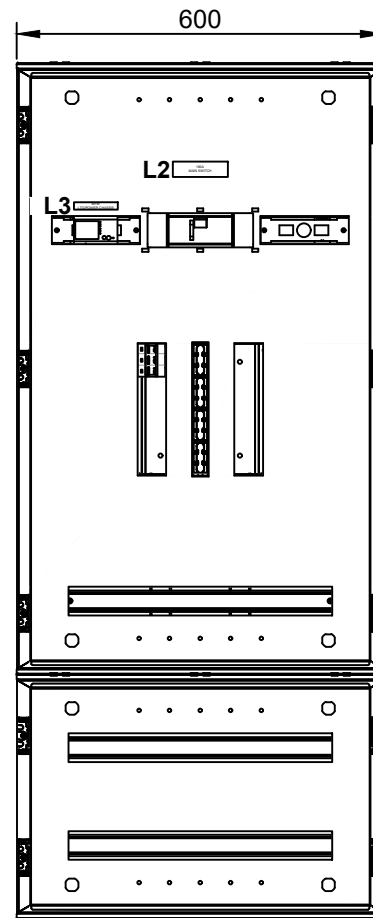


Date:

Revision	
----------	--

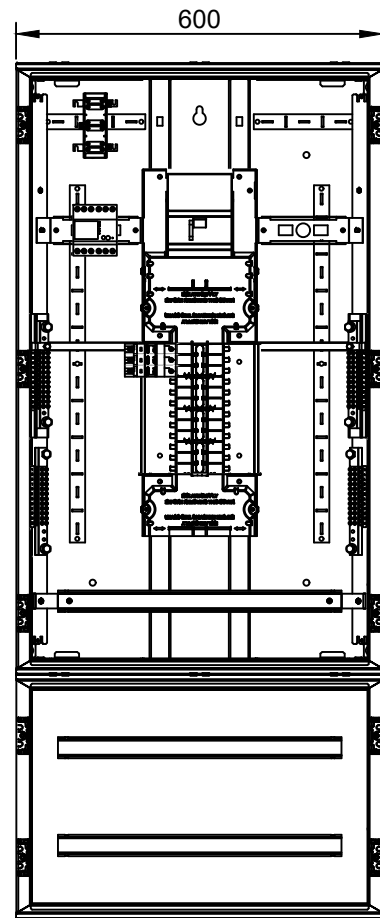

NOTES

- 1/ ALL SWITCHBOARDS ASSEMBLED & WIRED BY HAGER
ARE IN ACCORDANCE WITH AS/NZS 61439.1,
AS/NZS3000 AND THE SERVICE AND INSTALLATION
RULES OF NSW
- 2/ APEX + ENCLOSURE 2 X 8 POLE DIN AND
REMOVABLE 24 POLE DIN SECTION
- 3/ FAULT CURRENT RATED AT MCBs 6kA
FAULT CURRENT RATED AT CHASSIS 20KA
FOR 0.2 SEC
- 4/ FIELD REVERSIBLE DOOR AND HINGED ESCUTCHEON
SWING HANDLE WITH KEY LOCK
POSITIVE MCB ALIGNMENT
CIRCUIT IDENTIFICATION CARD
- 5/ VARIOUS INCOMER OPTIONS
- 6/ COLOUR: GREY RAL7035

EQUIPMENT SCHEDULE			
ITEM	QTY	CATALOG	DESCRIPTION
1	1	EC25250CT	Current transformer 250/5 2,5VA Kl. 1
2	1	JKM01	Multi-Function Meter Pulsed/Modbus Single Input (din mount) - 1 channel
3	1	JPA0EXTDW	APEX EXT BOX - 400MM - RAL7035 48 POLE DIN RAIL
4	1	JPACTTH2	CURRENT TRANSFORMERS MOUNTING PLATE
5	1	JPASMSEAL1	APEX APEX+ ELITE SMOKE SEAL1
6	1	JPD2400S25DW	DB, APEX+, 24P, 250A ISO-DIN-GR
7	6	JVC0PFL	SAFETY POLE FILLERS 1PK (10 pole fillers per pack)
8	1	MSN306	3-Pole MCB C CURVE 6ka 6A
9	1	PGMF1300AU	METER VOLTAGE SUPPLY CABLE - 1.3M
10	1	PGRJ500	RJ45 CONNECTOR CABLE 67 L7005 LSZH, 0.5M
11	1	STACK_ENCLOSURE	STACK AND FIT TWO ENCLOSURES

0	08/09/25	DP	DP		FOR APPROVAL							
Rev	Date	Drawn	Checked	Approved	Description	Rev	Date	Drawn	Checked	Approved	Description	

The information on this drawing is the property of Hager Electro. It is disclosed in confidence and is not to be reproduced, used or disclosed in part or in whole except for the purpose for which furnished.

WHOLESALE:

CONTRACTOR:

Cad File:

Date:

QUOTE NUMBER :

shagen

Title: OCULAR EVSE
EV-DB INDOOR IP43 24 POLE

LAYOUT

A3

Drawing No.

Sheet

2 of 3

Revisio

Revision
0

C