
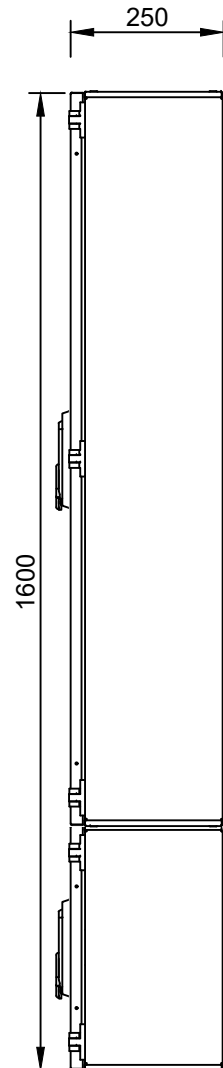
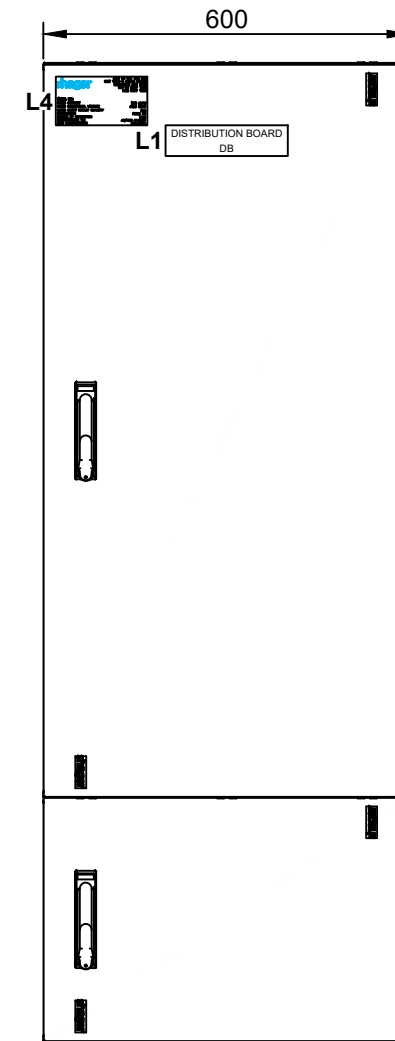
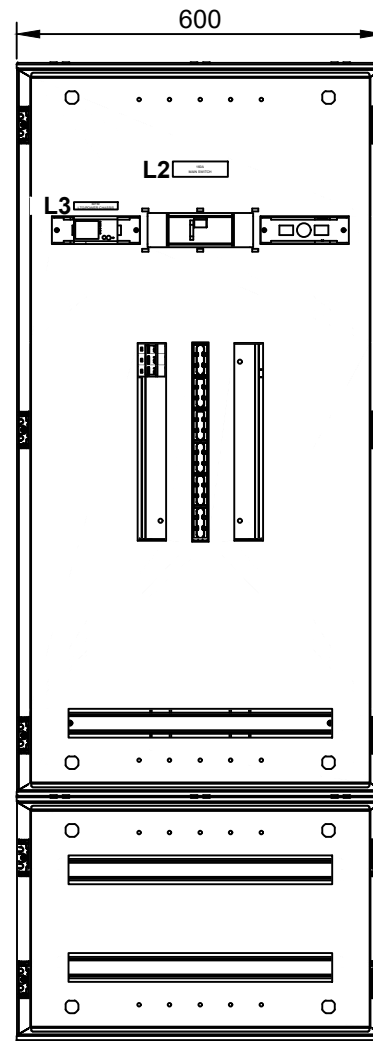


0

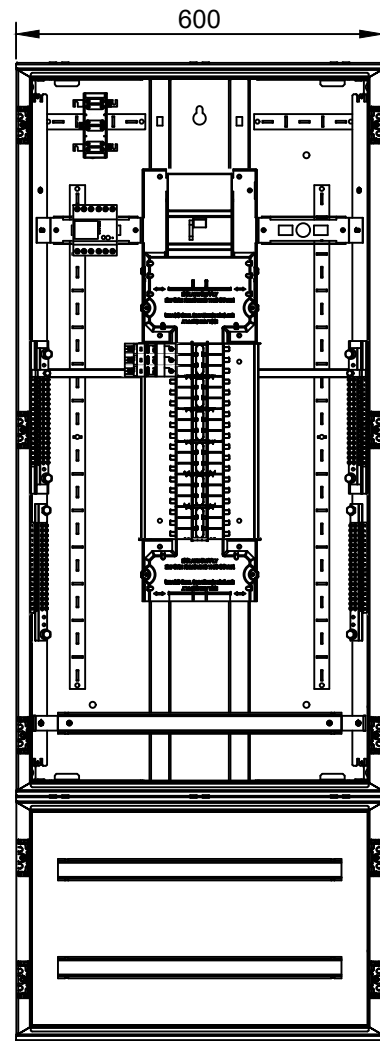

NOTES

- 1/ ALL SWITCHBOARDS ASSEMBLED & WIRED BY HAGER
ARE IN ACCORDANCE WITH AS/NZS 61439.1,
AS/NZS3000 AND THE SERVICE AND INSTALLATION
RULES OF NSW
- 2/ ELITE ENCLOSURE 2 X 8 POLE DIN AND
REMOVABLE 24 POLE DIN SECTION
- 3/ FAULT CURRENT RATED AT MCBs 6kA
FAULT CURRENT RATED AT CHASSIS 20KA
FOR 0.2 SEC
- 4/ FIELD REVERSIBLE DOOR AND HINGED ESCUTCHEON
SWING HANDLE WITH KEY LOCK
POSITIVE MCB ALIGNMENT
CIRCUIT IDENTIFICATION CARD
- 5/ VARIOUS INCOMER OPTIONS
- 6/ COLOUR: GREY RAL7035

EQUIPMENT SCHEDULE			
ITEM	QTY	CATALOG	DESCRIPTION
1	1	EC2S250CT	Current transformer 250/5 2,5VA Kl. 1
2	1	JKM01	Multi-Function Meter Pulsed/Modbus Single Input (din mount) - 1 channel
3	1	JPACTTH2	CURRENT TRANSFORMERS MOUNTING PLATE
4	1	JPE0EXTDW	ELITE EXT BOX - 400MM - RAL7035 48 POLE DIN RAIL
5	1	JPE3600S25DW	DB, ELITE, 36P, 250A ISO-DIN-GR
6	7	JVC0PFL	SAFETY POLE FILLERS 1PK (10 pole fillers per pack)
7	1	MSN306	3-Pole MCB C CURVE 6kA 6A
8	1	PGMF1300AU	METER VOLTAGE SUPPLY CABLE - 13M
9	1	PGRJ500	RJ45 CONNECTOR CABLE 67 L7005 1S2H, 0.5M
10	1	STACK_ENCLOSURE	STACK AND FIT TWO ENCLOSURES

0	08/09/25	DP	DP		FOR APPROVAL							
Rev	Date	Drawn	Checked	Approved	Description	Rev	Date	Drawn	Checked	Approved	Description	

The information on this drawing is the property of Hager Electro. It is disclosed in confidence and is not to be reproduced, used or disclosed in part or in whole except for the purpose for which furnished.

WHOLESALE:	
------------	--

	CONTRACTOR
--	------------

Cad File:

Date:

QUOTE NUMBER :

shager

Title: OCULAR EVSE
EV-DB OUTDOOR IP66 36 POLE

LAYOUT

A3

	Drawing No.
--	-------------

Sheet

2

of 3

2.

Revision

1

DISTRIBUTION BOARD
DB

160A
MAIN SWITCH

MFM
POWER CHASSIS

:hager

ABN: 84 061 639 576
UNIT 17/2-8 SOUTH STREET
RYDALMEERE NSW 2116
PH: 02 8867 7888
FAX: 8677 1866

SERIAL NO:

RATED CURRENT 250 AMPS

RATED OPERATIONAL VOLTAGE 415V 50HZ

RATED SHORT CIRCUIT CAPACITY 6KA

SEGREGATION FORM 2B

DEGREE OF PROTECTION IP66

MANUFACTURED TO: AS/NZS 61439.1

DATE MANUFACTURED SEP/2025

COLOUR: W-B-W
SIZE: 150 x 80
TEXT: ARIAL 3mm
MATERIAL: TRAFFOLYTE
FIXED: ADHESIVE

0	08/09/25	DP	DP		FOR APPROVAL						
Rev	Date	Drawn	Checked	Approved	Description	Rev	Date	Drawn	Checked	Approved	Description

The information on this drawing is the property of Hager Electro. It is disclosed in confidence and is not to be reproduced, used or disclosed in part or in whole except for the purpose for which furnished.

WHOLESALE:	
------------	--

CONTRACTOR:

Cad File:

Date:

QUOTE NUMBER :

:hager

Title: OCULAR EVSE
EV-DB OUTDOOR IP66 36 POLE

LAYOUT

Sheet	Revision
-------	----------

Sheet
3 of 3

Revision